


- NOTES:**
- RE-BAR TO BE #5 IN WALLS, 12" x 12", ONE LAP.
 - RE-BAR TO BE #5 IN FLOOR, 8" x 8", TWO LAPS OFF-SET.
 - CONCRETE TO BE 4000 PSI, PER ACI SPECS. 10" I WALLS, 12" IN FLOOR.
 - DRIVE DOWN SURFACE MUST BE PREPARED PER MACHINE MANUFACTURING SPECS REGARDING COEFFICIENT OF FRICTION.
 - PERIMETER WALL TO BE WATER STOP PROTECTED.
 - INSIDE WALL TO BE RE-BAR DOWELLED TO FLOOR.
 - INSIDE WALL RE-BAR SHOULD NOT BE CONNECTED TO FLOOR RE-BAR.
 - TIRE WASH DRAIN PIPE TO ENTER IN SEDIMENT SIDE, TIRE WASH PUMP TO BE LOCATED ON RE-CIRCULATION SIDE.

- DIMENSIONS:**
- TANK A: 80' LONG x 40' WIDE x 8' DEEP.
 - TANK B: 60' LONG x 30' WIDE x 6' DEEP.
 - TANK C: 40' LONG x 20' WIDE x 6' DEEP.

FOR CONSTRUCTION METHODS & DETAILS, RE-BAR TAKE OFFS, AND CONCRETE TOTALS, SEE SS DRAWINGS "SLOPED BASINS A,B,C."

STANTON SYSTEMS CLAIMS PROPRIETARY RIGHTS IN THE INFORMATION DISCLOSED IN THIS DRAWING. THIS DRAWING IS ISSUED IN CONFIDENT AND MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT WHICH IT IS SUPPLIED. FURTHERMORE, IT MAY NOT BE REPRODUCED OR DIVULGED TO ANYONE WITHOUT WRITTEN PERMISSION FROM STANTON SYSTEMS.

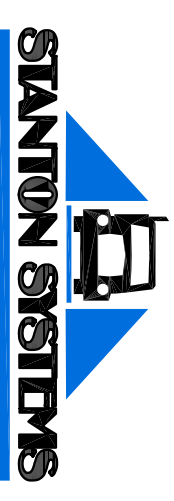

STANTON SYSTEMS
 36 VINCENT CIRCLE
 MYLAND, PA 18974
 (215) 956-9800 - (215) 956-1989 (FAX)

OVERVIEW

CONCRETE CLEAN-OUT

REVISIONS

BY

DATE:

4/25/05

APPROVAL TO BUILD CODE:

SHEET:

SCALE:

NONE

PRINTS SHALL NOT BE USED FOR CONSTRUCTION UNLESS CODE IS SUBMITTED TO BUYER FROM STANTON SYSTEMS

DRAWN BY:

N.D.S.

1

CHECKED BY:

CLEAN-OUT/DWG

JOB #: